

CITY OF ELY

501 Mill Street Ely, Nevada 89301

City Hall (775) 289-2430

Cityofelynv.gov

ELY MUNICIPAL UTILITIES BOARD REGULAR MEETING

March 10, 2022 8:00 a.m. – Ely Volunteer Fire Hall – 499 Mill Street – Ely, Nevada

Vice Chairman Dale Derbidge called the regular meeting of the Municipal Utilities Board to order at 8:00 a.m., led in the Pledge of Allegiance and asked for Roll Call.

Members present:

Vice Chairman Dale Derbidge

Member Greg Rivero

Member Sherrie Marquez

Members absent:

Chairman John O’Flaherty

Member Ken Ross

City Officials and staff present:

Councilman Kurt Carson

City Clerk Jennifer Lee

City Treasurer/HR Director Janette Trask

City Engineer BJ Almberg

City Attorney Leo Cahoon

City Public Works Supervisor Mike Cracraft

City Administrative Assistant Patti Cobb

Also, in attendance: Members of the public in attendance at the Ely Volunteer Fire Hall signed in (appears below):

MUNICIPAL UTILITIES BOARD ATTENDANCE LIST

DATE: March 10, 2022

Print name below

Frederick Parthey
George Chachas

Print name below

2. PUBLIC COMMENT

George Chachas stated on your agenda item C-2 you are to consider the possible approval of provisions to provide the County Golf Course with water. They need to pay the same rate as others do now. Your auditors have always stated the City needs to charge all entities for the use of water the same rate that has been established for their particular class of operation. The city and county governments are required to know the true costs of operating their different functions. I want to remind you the County Commission gave free golf to their friends and family; had they collected proper fees from everyone, they would have enough money to pay for their water bill. I have asked in the past and am asking again, did the Golf Course get caught up with their previous bill? If not, then this item needs to be tabled and turned down. Federal law prohibits discrimination in any federally funded or assisted public utility. I want to remind you the so-called negotiating team from the County is the same team that bent the City over and strangled them with a burdensome police contract. They then refused to negotiate a fire assistance contract, which would have given the City some relief from the police contract. The County just recently found money to hire a \$135,000.00 a year county manager, which they didn't need, and another \$100,000.00 for an early buy out for Elizabeth Frances in retirement; that doesn't include the twenty-five percent raise she got last year. For them to cry poverty is baloney. I remind you golf is a luxury and not a necessity; those that want to play need to pay. Nothing has been done to relocate the sewer connection on my family's lots on Great Basin Boulevard; two sewer connections on the lower lot and no connections on the upper. I want equal protection under the law. At 745 Great Basin I have not been reimbursed for the damage and repair that was done to the water shut off when Q & D was doing their work; I want the same consideration as others. Also on the lower lots, the meter pits have not been put in and others got meter pits. The NDOT project put up a barbed wire fence around the creek in Central Ely and barbed wire is not allowed in the City limits per City Code.

3. ITEMS FOR DISCUSSION/POSSIBLE ACTION OF THE UTILITY BOARD.

A. CONSENT AGENDA

MOTION: Move to approve the Consent Agenda item 3A-1 Minutes.

The consent of the February 10, 2022 meeting minutes was moved forward to the next Utilities Board meeting due to only two members being present that were at the last meeting.

1. Discussion/For Possible Action –Minutes.
 - February 10, 2022

B. OLD BUSINESS

1. Board Members – *Robinson Nevada Mining Company* (RNMC) representative – Discussion only – Update to the Utility Board on the *Robinson Nevada* Development, Ruth Pit Development and water mitigation efforts within the City of Ely.

RNMC Environmental Manager Frederick Partey, stated we continue to mine in the Ruth pit and as part of that we need to continue to dewater. We are dewatering about 10,873 GPM and out of that about 4,029 gallons are going to Gleason Creek. 0 GPM is coming

from RW-7P, which we will talk further about today, and the rest goes to the mill for ore processing.


C. NEW BUSINESS

1. Councilman Carson – *Robinson Nevada Mining Company* (RNMC) representative – Discussion only – Review of RW-7P parts-on-hand list, including where said parts are stored and the RW-7P RNMC chain of command contact list; and proposed timeline to develop RW-7P Emergency Response Plan, in coordination with City Public Works Supervisor Mike Cracraft.

Councilman Carson stated we agreed to this sometime ago and I think it fell through the cracks. I think it is imperative to have an emergency response plan for the wells in the City so we know who to contact, what parts are available, and where they are.

Environmental Manager Frederick Partey stated Jennifer requested that I or someone from Robinson Mine be here in person today to respond to some of the questions the Municipal Utility Board may have. I was available today, but I do travel a lot and am not usually available to come to this meeting.

Environmental Manager Frederick Partey presented the following and stated I got a call on January 22, 2022 from the City Water Department; usually Carl is who I talk to. We always have a critical spare pump and motor for RW-7P on hand.

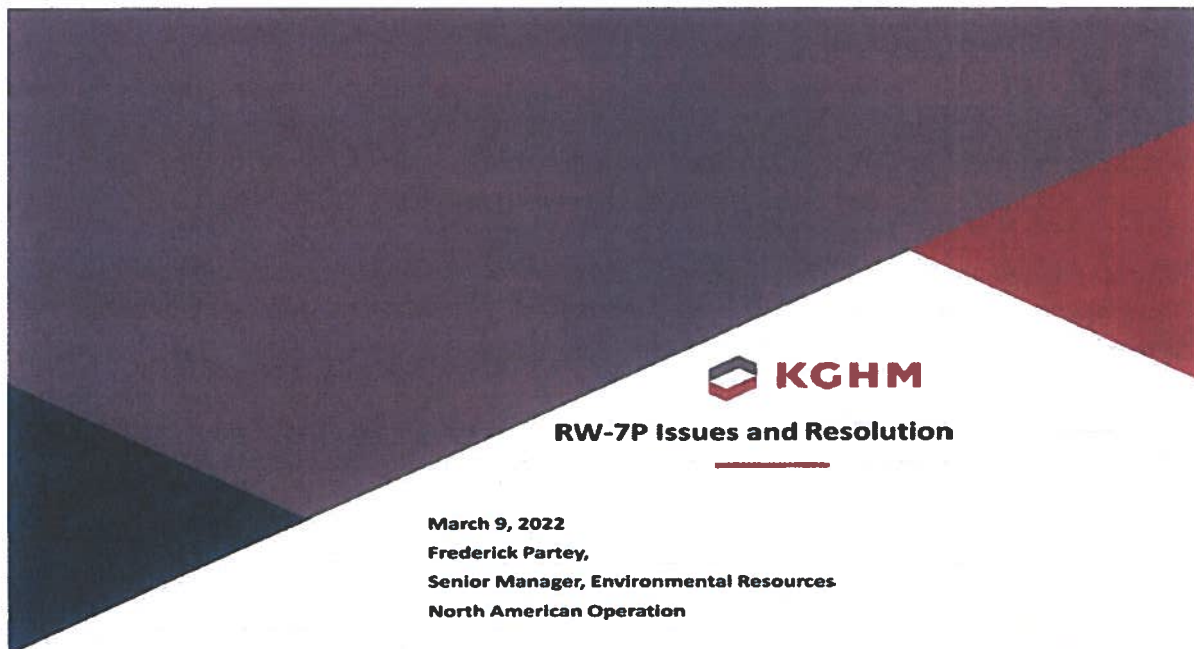

RW-7P Pump and Motor Failure Outline

1. Overview of what happened
2. Review of RW-7P parts-on-hand list
3. Where parts are stored
4. RW-7P RNMC chain of command contact list

Robinson Nevada Mining Company



RW-7P Pump and Motor Failure

On January 23, RW-7P experienced a catastrophic failure of the primary **motor** associated with potable water supply well RW-7P (W08).

The failure was determined to be caused by a downhole ground fault (an inadvertent contact between an energized conductor and equipment frame) rendering the **motor inoperable**.

Upon this discovery, RNMC collected the on-site **critical spare pump and motor** and had them installed at the water supply well on February 4, 2022.

Immediately following completion of the install, a failure of the **critical spare pump** was observed.

The **critical spare pump** assembly has subsequently been sent back to the manufacturer where the cause for the failure is currently being investigated.

Robinson Nevada Mining Company



RW-7P Pump and Motor Failure Continued

A second attempt to bring water supply well W08 back into operation was made on February 17, 2022 utilizing the **critical spare motor** paired with the **old (initial) pump**.

This combination also proved to be unsuccessful as flow from the well could not be achieved.

Due to the excess time constraints associated with sending these components back to the manufacturer to determine the cause of failure (>16 weeks).

RNMC contacted our pump vendor (Jim Rosser)- immediately

Jim came up with two options (March 3) for RW-7P as follows: Neither option includes startup services and utilizes the existing column pipe and power cable.

Robinson Nevada Mining Company



RW-7P Pump and Motor Failure Continued

Old Pump and Old Motor

~~Old motor~~ — ground fault-

Spare Pump and Motor - Available Installed

~~Spare pump failed~~—Reason for failure- under investigation

Spare motor and Old pump- No flow- reason for no flow is mechanical and electrical problem

Robinson Nevada Mining Company



Environmental Manager Fredrick Partey stated the reason for the wait is you have to soak the pump for a potable water system to make sure nothing is going to come out of it for a long period of time. If the application for option 2 is approved it could be available in as little as six weeks. At the point of filling out the application for option 2 we contacted B.J. to work with the local utilities. We filled out the form and wrote a letter of explanation of what has taken place and the reason it is critical for us not to wait the sixteen to eighteen weeks. In April and May people will start watering their lawns and we will need more water than we are using now and this pump and motor need to be expedited. If this application is not approved, we will need to know right away so we can figure out what our next steps are going to be.

RW-7P Pump and Motor Options

Option 1 NSF Certified Integrity Pump/Hitachi Sun Star Motor

This option is a 6 Stage submersible turbine capable of 1500 GPM @ 800' TDH pump with a 450 HP Motor. The complete package is provided by Integrity Pump. Estimated lead time is 16-18 weeks. This would include a pump crossover with shroud donut hanger and 16" shroud

Option 2 Schlumberger System

This is a 4 Stage N1400 Pump with a 400 HP 2411V volt motor capable of 1500 GPM at ~800' TDH. Motor and Protector are filled with food grade oil. Estimated lead time is ~6 weeks. It is my understanding that the equipment complies with NSF per the attached letter and they are currently undergoing application with hopes of approval within the next year.

Robinson Nevada Mining Company



RW-7P Pump and Motor -BSDW

RNMC contacted BSDW supervisor on March 3 to find out if option 2 could be permitted by the BSDW.

BSDW responded on March 4 as follows -there is a regulation in NAC 445A that allows a water system to submit a request to use non-certified NSF 61 products.

A copy of the regulations were sent to RNMC, and was instructed to work with the public water system to submit an Application for Approval of a Water Project, with two hard copies of all documents, an electronic version, and a \$300 review fee.

The application package is completed and should be submitted by end of the week.

Robinson Nevada Mining Company



Councilman Carson asked with 6-P permanently down and 7-P being our main well for town, is the Mine kicking around the idea of drilling another well? I know that has been talked about in the past.

RNMC Environmental Manager Frederick Partey stated Jennifer wrote a letter to Amanda in regards to getting the Golf Course well up and running so it can get off of the City water; I will let Amanda respond when she returns.

City Clerk Lee stated for clarification that letter referred to the Golf Course irrigation well for irrigation purposes for the Course, not a culinary well.

Member Derbidge asked if you go with option 2, will you have two of those so you have a backup if that one goes down or will you go back to the first one.

RNMC Environmental Manager Frederick Partey stated we will go back to the first one. Option 2 is just an interim measure so we have water from 7-P and then we will order two spares which will be the option 1, because option 1 is what we need to have at all times. Option 2 is just to mitigate the situation we have right now.

Councilman Carson stated with that being said, would it make sense to order the certified pump right now since we know we are going to use that?

RNMC Environmental Manager Frederick Partey stated yes. We are ordering that right now. We always keep a spare motor and pump and reviewed the slide below of RW-7P Parts-on-Hand List and where they are stored.

RW-7P Parts-on-Hand List - Where They Are Stored

Critical Spare motor (currently downhole) – 450 HP Sun Star SSEI Type D Submersible Motor

Critical Spare pump (currently in SLC being evaluated for failure) – Gould’s pump model 11CLC 3-Stage bowl assembly turbine

Critical Spare cable (currently pushed downhole) - #25kV flat jacketed submersible cable

The pump that had been in operation since September 2020 until the motor failure on January 23, 2022 was a Gould’s pump model 11CLC 4-stage bowl assembly turbine.

The failed motor was also a 450 HP Sun Star motor. The 4-stage pump was pushed back in after the catastrophic failure of the critical spare pump.

The old failed motor from the January 23 is being stored at the upper warehouse laydown. The original cable is spooled at the same location.

All of the RW-7P critical spare parts are stored in a warehouse laydown yard.

RNMC Environmental manager Frederick Parthey stated there are tiny things we bring in so what I am talking about is the major critical parts and if they don't function, we don't have water coming out of the well. If Carl calls me and says 7-P is down and somebody needs to come and check most of the time their problem is resolved; what happened on January 10, 2022 is rather unfortunate. The last question Jennifer asked me to address is the RW-7P Chain of Command Contact List. I am the main contact between the Mine, City, and County and that is not going to change. Anytime the wells go down Carl will call me, and once he calls me, I am able to get an electrician to come in and diagnose what could be wrong. Sometimes we are able to restart it and then there are times like we had in January that we do have catastrophic failure. I will remain the point of contact between the City and the Mine. If there are any issues or anything that needs to be done, I will be the point of contact and that is how we have operated. I wish Carl was here to say if there was a time he tried to call and couldn't get a hold of me and been in a position where he feels he is not getting response to his questions; I would have been happy to answer. I have been very responsive and working with Carl very well on 7-P and any other things that need to be done. Even with the wells in town, most of the time when things happen Carl will call me, or I will get a call from Basin Engineering when there are problems. We work on them and usually resolve them.

RW-7P Chain of Command Contact List- RNMC

RNMC Contact List:

Frederick Parthey- 1st Point of Contact
Senior Manager, Environmental Resources
T +1 775 289 7040
C +1 775 293 5261
frederick.parthey@us.kghm.com

Robinson Nevada Mining Company



Councilman Carson stated you have been very responsive to the City, but you did say you are traveling a lot so if there is another contact person we could have that would be greatly appreciated.

RNMC Environmental Manager Frederick Parthey stated I will talk to Amanda about it, but like I said I travel but have my cell phone and that is how I respond. We will try to

get somebody, but the issue is, because of my background and knowledge of what we have done in the last seven to eight years it's really important that I keep in touch with everything that is going on. If I am not available or unable to respond we will make sure there is someone to replace me. Right now, I want to keep it that way because of my background, knowledge, and my relationship with Basin Engineering.

City Engineer Almberg stated you talked about the temporary pump and the two certified pumps. Is it the intention the temporary pump will be pulled in sixteen weeks when the new pumps show up?

RNMC Environmental Manager Frederick Partey stated yes, both will be pulled. If you remember, we took the old pump that was in, there when everything broke and then when we put the new critical replacement in it was the motor that failed. Now we have an old one and a new one in combination, so we want to make sure we have everything brand new.

City Engineer Almberg stated I understand exactly where we are with everything that went on. The question is you have said the non-certified pump that is a water quality pump, but is just not certified, is the temporary one that will go in. Then you were going to order two NSF-61 certified pumps and motors later in the summer when the temporary one shows up in six weeks that will go down the hole and in fourteen to sixteen weeks when the certified one shows up, you are going to pull the old one out and put the new one in?

RNMC Environmental Manager Frederick Partey stated yes. We will pull it out and put the new one in because that is the right thing to do. We want to make sure we have NSF-75. We are asking for this exemption because of the circumstances, but once we get the NSF-75 we will pull it and replace it.

2. Board Members – City Engineer Almberg – Discussion/For Possible Action – Recommendation for approval of the following terms through October 31, 2023 for provision of water services to the White Pine County Golf Course, to include, modify or exclude the following: 1. Water usage period begins April 1st through October 31st; 2. Ruth rate applied per monthly allotment amounts outline in Monthly Allotment chart for an annual total of 62 million gallons, with monthly allotments not carrying over; 3. Water used over monthly allotment billed at current City of Ely water rates; City Engineer will monitor City's water tank levels and notify White Pine County Public Works Director if Golf Course watering needs to be temporarily reduced; and two year agreement contingent on White Pine County's commencement of drilling irrigation well at the Golf Course.

City Engineer Almberg stated this sheet is what we put together when discussing these water rates with the County. When the County requested we come back to the table to talk about this, one of the things they requested was seventy million gallons. The gallons that are on this sheet are based on last year's water usage and we came back to a consensus of sixty-two million instead of the seventy they originally requested. This is based on what we call real numbers and not just calling up Golf Courses and asking,

“how much water did you use.” The committee felt comfortable with that number as we had meter readings every day last year and what we took into account to get to the sixty-two million is in April and May last year, the County in a sense was trying to bank their water because it was allowed to carry over. There was a fear they were going to run out of water at the end of the year and have high water bills, so they were trying to be conservative but it was hard on the Golf Course. Recognizing that and looking at the numbers this is a consensus of a breakdown we had come to through the committee. The County anticipated that some of the meter readings in later August and September may have been a little higher than they needed to be because they had starved the grass at the beginning of the year, so they were trying to catch back up. The anticipation the way this is set up is to let them use water at the beginning of the year to get the grass healthy so it can handle it being a little dryer during the summer months. The billing rate is a GID rate, and I hear people say we have to charge everyone the same. The way to look at this is it is the GID rate we charge other government entities, and this is a government entity of White Pine County; there are valid reasons why this is potentially acceptable. The Agreement shows the breakdown. With the status of RW-7P right now and if it is a very dry summer and we have trouble maintaining our water depths in our water tanks, we want to be able to curtail water as needed. Between our negotiations it would be best if the two entities could coordinate without having to come back to the Council Meeting or Utility Board Meeting to request to turn these tanks down. When we do it, we want to do it in real time and make it efficient.

Member Rivero moved to recommend approval of the following terms through October 31, 2023 for provision of water services to the White Pine County Golf Course, to include, modify or exclude the following: 1. Water usage period begins April 1st through October 31st; 2. Ruth rate applied per monthly allotment amounts outline in Monthly Allotment chart for an annual total of 62 million gallons, with monthly allotments not carrying over; 3. Water used over monthly allotment billed at current City of Ely water rates; City Engineer will monitor City’s water tank levels and notify White Pine County Public Works Director if Golf Course watering needs to be temporarily reduced; and two year agreement contingent on White Pine County’s commencement of drilling irrigation well at the Golf Course. Member Marquez seconded the motion. The motion carried unanimously.

Proposed Golf Course Water Usage and Rate (2022 – Rev. 2)

- Anticipated water use will begin April 1st and end October 31st (7 months).
- County would pay the Ruth Water rate for a total allotment amount of 62 million gallons.
- Monthly billing would be based on water usage from the meter readings. Any water uses over the monthly allotment will be billed at the current City of Ely water rates.
- If the monthly allotment is not used, it does not carry over.
- The 62-million-gallon allotment was determined from last year’s meter readings and taking into account the reduced water usage in the months of April and May.
- This is an interim agreement with the main objective to get the Golf Course on its own well and remove the high demand from the City of Ely system.
- With the current status of RW-7P well not inoperable. The City has the right to reduce and/or turn off the golf course irrigation water as required to maintain fire protection for the community.
- In the event that the City Wells are unable to maintain a minimum level of 25 feet within the courthouse tanks, the curtailment of the golf course irrigation will begin.
- In the event the City’s main 17th and M Well or the Golf Course Municipal Well are not operational, curtailment of the golf course irrigation will begin, regardless of the water elevation in the courthouse tanks.
- The curtailment will be coordinated between the City Engineer and the White Pine County Public Works Director.
- This agreement is meant to provide the County one (1) year to get the Golf Course on its own well.

Monthly Allotment	
Month	Volume (Gallons)
April	6,000,000
May	8,000,000
June	12,000,000
July	12,000,000
August	12,000,000
September	10,000,000
October	2,000,000

3. Board Members – City Clerk Lee– Discussion/For Possible Action – Recommendation to remove past due utility fee penalties up to the amount of \$264.45 from 41 Sixth Street, McGill, Nevada at the request of property owner, Robert McShane.

City Clerk Lee stated Mr. McShane paid the past due landfill fees on the 8th of February and he is requesting a waiver of the remaining penalties.

Vice Chairman Derbidge stated this is in line with what we have been doing.

Member Marquez moved to recommend the removal of past due utility fee penalties up to the amount of \$264.45 from 41 Sixth Street, McGill, Nevada at the request of property owner, Robert McShane. Member Rivero seconded the motion. The motion carried unanimously.

4. Council Members – City Clerk Lee – Discussion/For Possible Action – Recommendation of Approval of Water and Sewer Assistance Program Vendor Agreement between the State of Nevada Department of Health and Human Services Division of Welfare and Supportive Services (DWSS), and Energy Assistance Program-Water Assistance and Sewer Program (EAP-WSAP).

City Clerk Lee stated this is based on a grant the State received, so it may not be long-term. It is set up similarly to what our County Social Services is and has been reviewed by the City Attorney. He requested the verbiage regarding their commitment for payments be binding and the State did incorporate those changes for us.

Member Marquez asked does the money come directly to the City of Ely.

City Clerk Lee stated yes, just like the County.

Vice President Derbidge asked is this just for one year?

City Clerk Lee stated to be frank, I believe it is until the funds run out or the grant gets renewed, was my understanding from their representative.

Member Marquez stated we have a similar program at Mount Wheeler Power, and it has been very helpful.

City Clerk Lee stated in my position I do see a need.

Member Rivero moved to recommend approval of the Water and Sewer Assistance Program Vendor Agreement between the State of Nevada Department of Health and Human Services Division of Welfare and Supportive Services (DWSS), and Energy Assistance Program-Water Assistance and Sewer Program (EAP-WSAP). Member Marquez seconded the motion. The motion carried unanimously.

4. CITY DEPARTMENT REPORTS

➤ CITY ENGINEER

City Engineer Almberg stated one of the things I forgot to say earlier during the discussion regarding RW-7P was he sent another sensor they want to put down in that hole with that motor. It senses more things and will provide more protection from burning up such as monitoring the temperature. What I told him is we would submit that along with anything that went to the State and let the State make that determination if it is ok for that to be down in the hole of the potable water well. I think the desire to put some additional monitoring, so we don't just keep running it until it breaks, is a good thing. It looks like our earmark for sewer funding is going to be coming through here shortly; it passed the House and I believe the Senate is supposed to vote on it by this weekend. This time next week we will have a better idea if it does happen. The funding is to replace some of our sewer mains in the Central Ely area. On the 29th of March we have our presentation for CDBG which is

also a request for some of these mains down in Central Ely. It is a very old section of our sewer system, and it probably handles about seventy percent of the town. We are also working with the PORTER Group, who is the City's lobbyist to obtain some of these earmarks. If we do get funding for the 2nd phase of the sewer project and Aultman Street, we will have ninety percent of the main sewer completed. We are spending a lot of time with the PORTER Group getting all the paperwork together. The Murry Street Project, which is a CDBG funded project for this year, is pending CDBG review to make sure it meets all requirements; we have all the plans and bid package completed and it should go under construction hopefully in the next month and a half to two months.

Vice Chairman Derbidge stated if we have a pump and motor in the well and then a spare, do they ever run the spare one or two thousand hours and then pull it out to see if it is running efficiently?

City Engineer Almberg stated that is a good thing you brought up. Our Golf Course motor from that well is being refurbished right now. They picked it up last week and we heard back from them yesterday. They have it torn apart and tested, and we should get the report back later this morning on what they found and a cost estimate to fix anything they discovered and get it back to us. They estimate it will be back to us in the next several weeks.

Vice Chairman Derbidge stated that is not my question. My question is if we put a new motor and pump down RW-7P and have a spare motor and pump, after so many months or hours, do they pull them?

City Engineer Almberg stated the cost is prohibitive because it is such a big, deep well and takes big equipment to come in and do that. Every time they come and pull this thing out of the ground is pretty substantial.

City Clerk Lee stated not to interject, but I thought you were asking about the spare pump and motor that are in storage somewhere as far as checking those periodically.

Vice Chairman Derbidge stated if it is a brand new one sitting there it shouldn't have any trouble.

City Clerk Lee stated in the case of what happened here it was not brand new, correct?

City Engineer Almberg stated they were brand new, so I am not sure what happened there.

Vice Chairman Derbidge stated I just thought it might be like the engines out at the Mine, after so many hours they switch them because they don't want them to completely disintegrate.

Councilman Carson stated it is sporadic on how long they run, it seems like.

City Engineer Almborg stated I think that is why they want to get this other sensor down in the hole so they can see exactly what is going on and have another form of protection on those motors. I think through some of our discussions we have been having, one of the things that had come out of it is exactly what Kurt was asking today: what is the status and how are these things stored. If they are going to buy us a spare pump and motor to go down in there, we should probably store that in our pump house. We have the room and then there is no question of where it goes or where it is, so when it breaks down there is no going to find something that has been sitting on the shelf for two years.

Member Marquez asked do the seals get dried out if they are stored too long?

City Engineer Almborg stated they should go and spin the bearings and keep them active, so they don't sit for five years and never move.

5. PUBLIC COMMENT

George Chachas stated I am disappointed Mr. Chairman that you took off public comment on all items like has been done in the past.

Vice Chairman Derbidge stated you can have a choice on public comment to have it in the front, back, or in between and I chose to do it this way. Chairman O'Flaherty will be back next meeting.

George Chachas stated in previous meetings I have reported RVs, possibly squatters, are setting up throughout the City. I have asked if you have billed any of them and I have yet to receive an answer. I have noted more than one time an RV across from Councilman Alworth as well as Mr. Carson. Again, we either have rules that pertain to everybody or nobody. I am still not getting permits to rent my property. You are selectively enforcing the law and I am going to blame all of you for selective enforcement. It's got to stop. What the hell do you sit on this Board for? I want equal protection. I have evicted at least four people off of my properties and yet you look the other way for others throughout the City. Are you billing them, because if you are not let me tell you, you have got a problem because I am going to file a complaint against you. You took an oath to enforce the law and you are not doing it. I have asked in the past and am asking again if the City ever collected for sewer, water, and landfill services from the Historical Railroad when they owned the White Pine Trailer Park? I want to know if it was tens of thousands of dollars like the Golf Course owes or has paid. We don't know do we. I want to know if the City has addressed collection of utilities from the Garnet Mercantile outstanding for the old bank building which is now known as the Art Bank. You are going after individuals for no reason at all, your attorneys in the past were lazy, and that's why you have those high fees and penalties.

You haven't corrected the property that I own at 490. I paid in full and paid the penalties in full that you have waived for everybody else and yet you still have me owing \$1,600.00. You haven't given me proper credit for properties that I have overpaid, and you have staff that is not doing their job and you need to correct that. I have asked in the past if you folks have notified Mt. Wheeler Power that they have to move some of their power poles in regards to the Murry Street Project? They are inhibiting ADA access. New project, federal regulations...you can't do that.

6. ADJOURNMENT: THE MEETING MAY BE ADJOURNED BY APPROPRIATE MOTION OF THE MUNICIPAL UTILITY BOARD

Vice Chairman Derbidge adjourned the regular meeting of the Municipal Utilities Board at **8:45 a.m.**



Vice Chairman



Attest

